
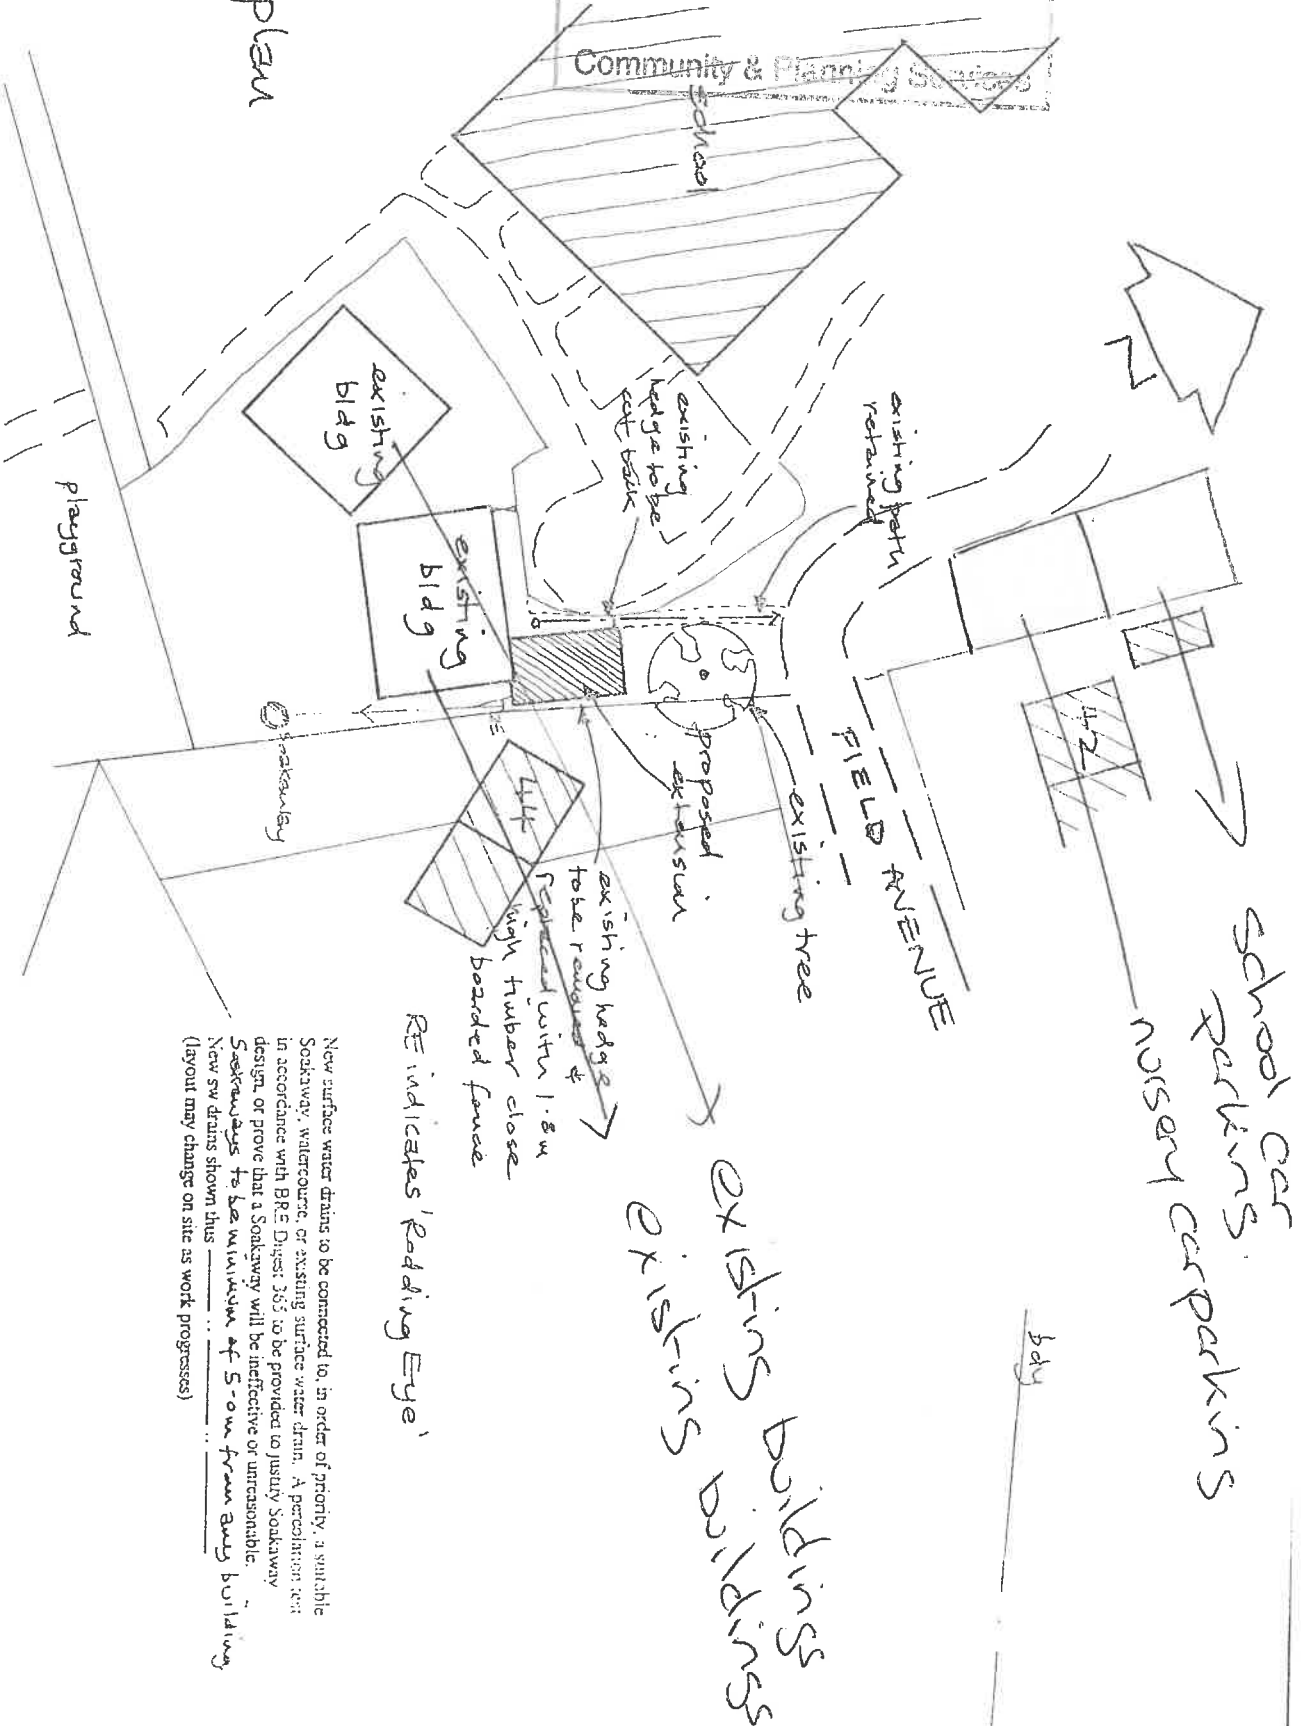


block plan
1:500.




New surface water drains to be connected to, in order of priority, a suitable soakaway, watercourse, or existing surface water drain. A permeation test in accordance with BS 5261:3:65 to be provided to justify soakaway design, or prove that a soakaway will be ineffective or unreasonable.

~~Soakaways to be minimum of 5.0m from any building.~~

New s/w drains shown thus _____

(layout may change on site as work progresses)

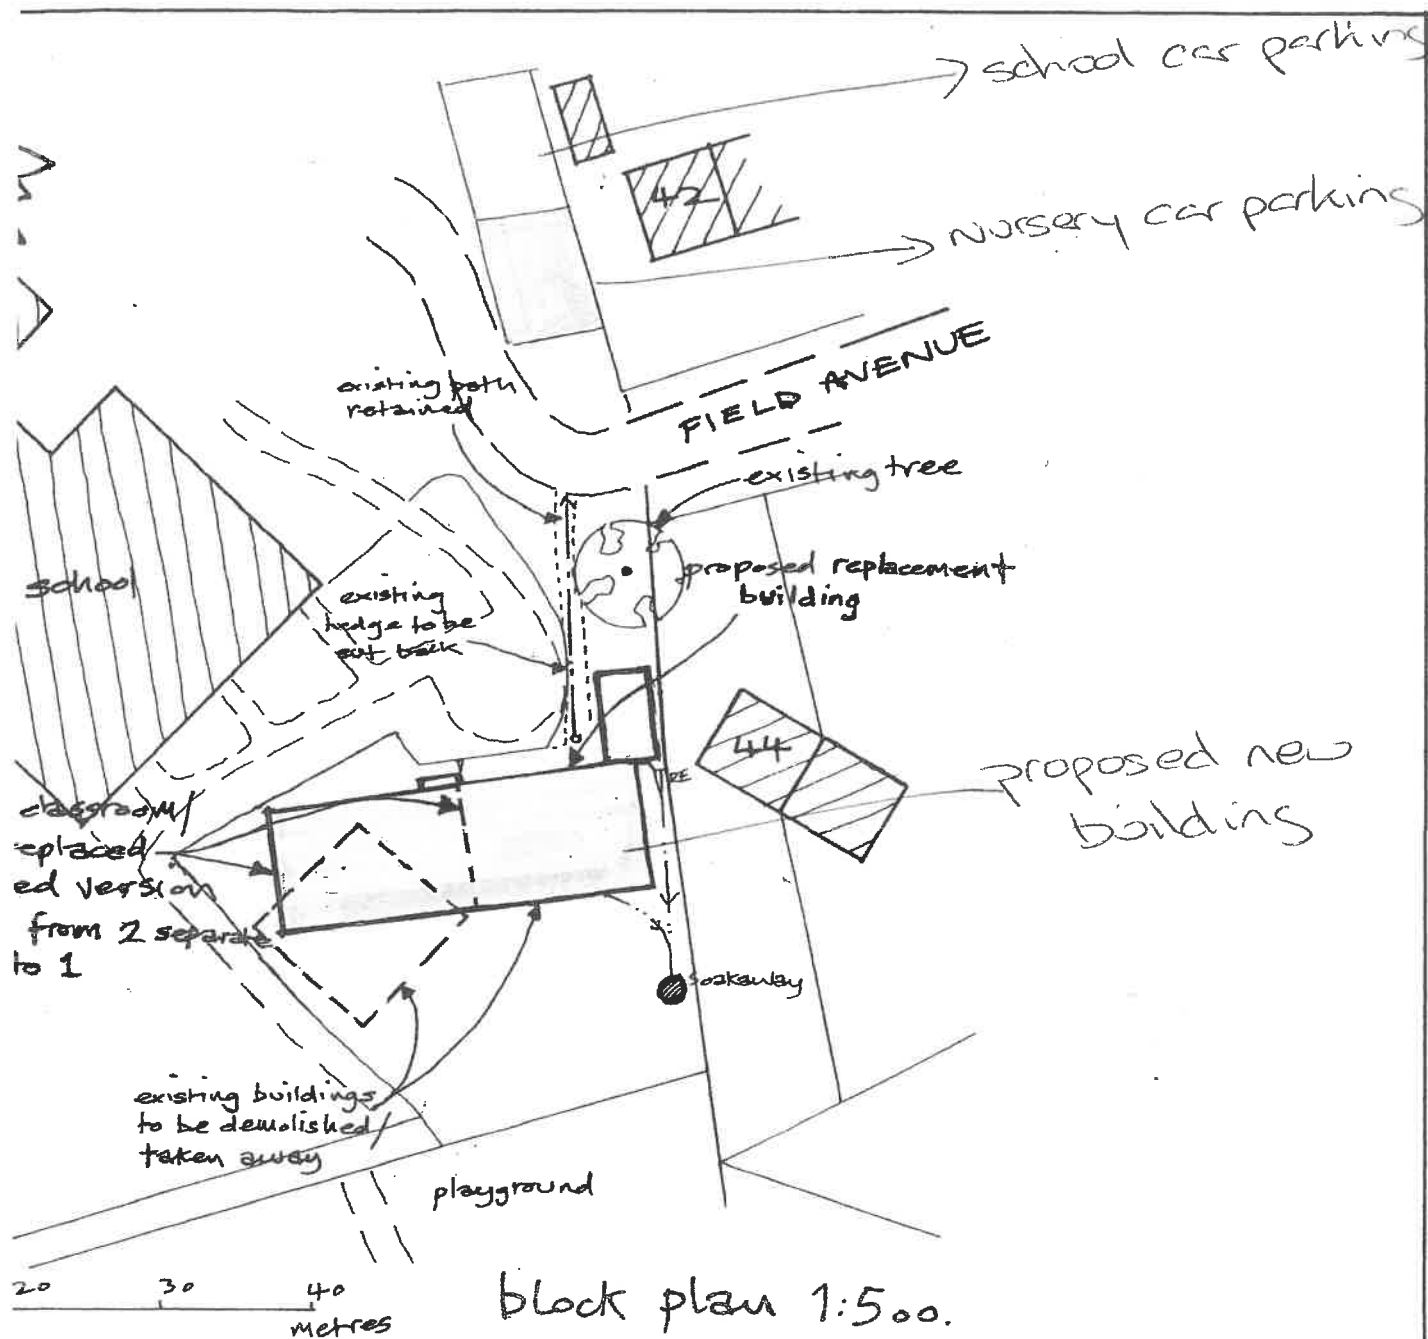

9135

