


Proposed Plot 23 Path Link

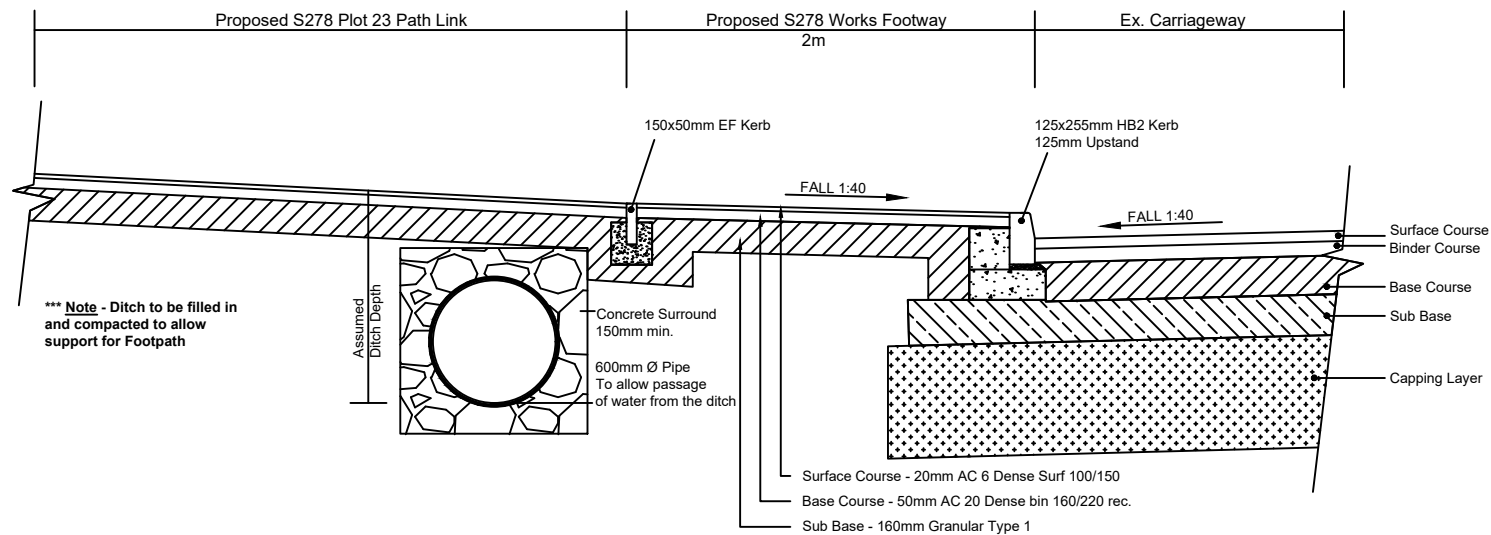



CBR Value 1.5 - 1.8%		
CBR Value	Capping Layer Thickness	Sub-Base Thickness
Less than 2%	550mm	200mm

To be Designed to Derbyshire CC Spec.



NOTES.

No material within 450mm of finished road surface shall be frost susceptible. A minimum total construction thickness of 450mm shall be required over frost susceptible materials.

All trench backfill shall be Granular sub-base Type 1 of Type 2. Where trench backfill material is above the 300mm line materials shall be as described in Clause 505 & 507.7 of SHW

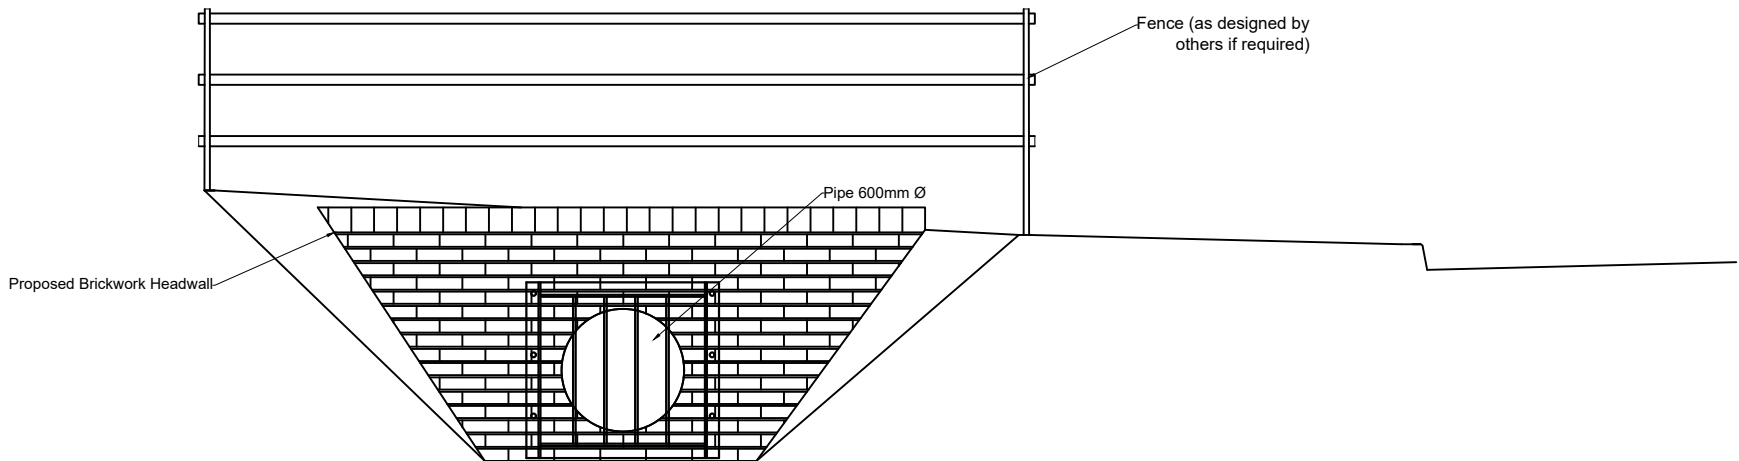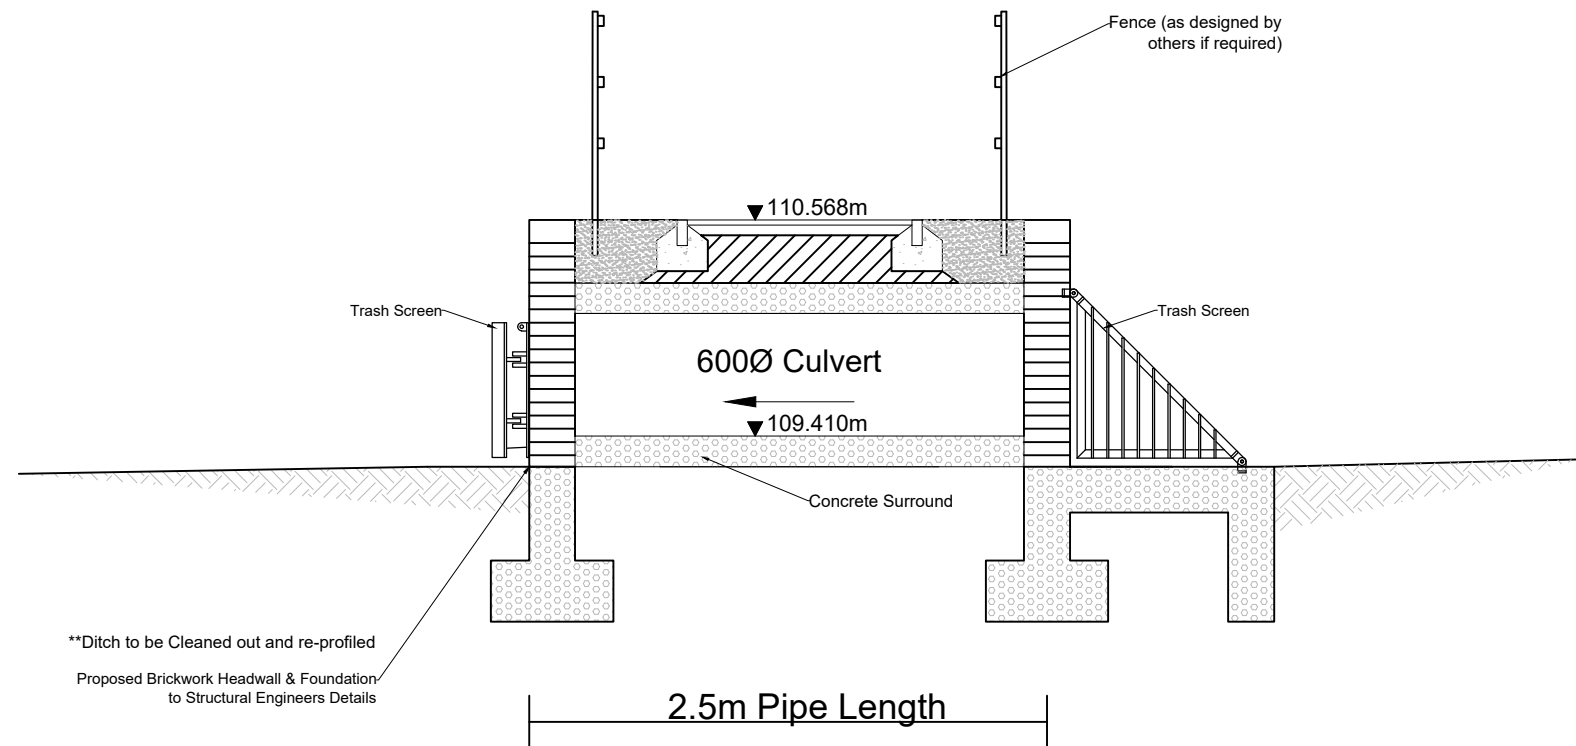

Grating manufactured from 70 x 70 angle frame with 60 x 12 flat at 140mm centres. Fully Welded and hot dip galvanised.

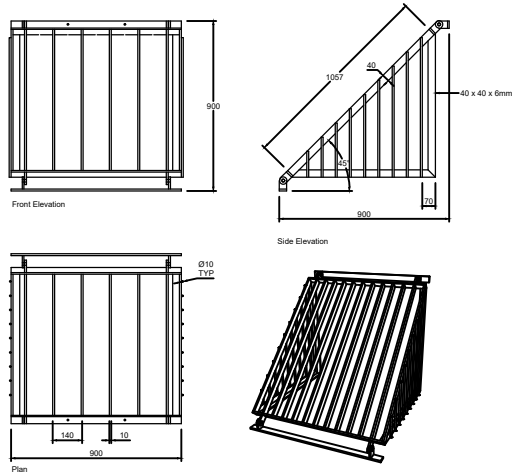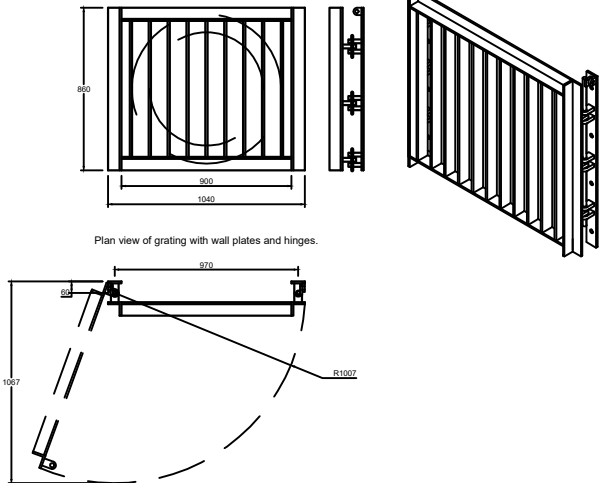

© 2018 RPS Group

Notes


- This drawing has been prepared in accordance with the scope of RPS's appointment with its client and is subject to the terms and conditions of that appointment. RPS accepts no liability for any use of this document other than by its client and only for the purposes for which it was prepared and provided.
- If received electronically it is the recipients responsibility to print to correct scale. Only written dimensions should be used.

PRELIMINARY

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT DESIGN DRAWINGS AND OTHER INFORMATION

B	Amendments made to Trash Screens as requested by DCC.	31.01.19	NJEJ	CW
A	Detail amended to Suit Latest Council Comments. Latest Logo added to Title Block	17.01.19	NJEJ	CW
Rev	Description	Date	Initial	Checked

For guidance only. Do not scale off this drawing

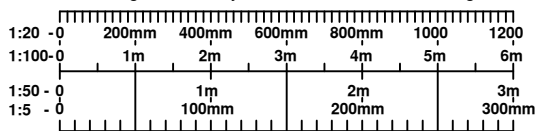

Salisbury House, 2A Tettenhall Road,
Wolverhampton, West Midlands, WV1 4SA
T: 01902 925500 E: rpswlv@rpsgroup.com

Client Walton Homes LTD.

Project Land Off Linton Heath,
Swadlincote

Title Proposed Plot 23 Path Link Details

Status	Drawn By	PM/Checked by
Preliminary	NJEJ	AG
Job Ref	Scale @ A3	Date Created
AAH5326	NTS	02.01.19

Drawing Number	Rev
810	B

rpsgroup.com/uk