



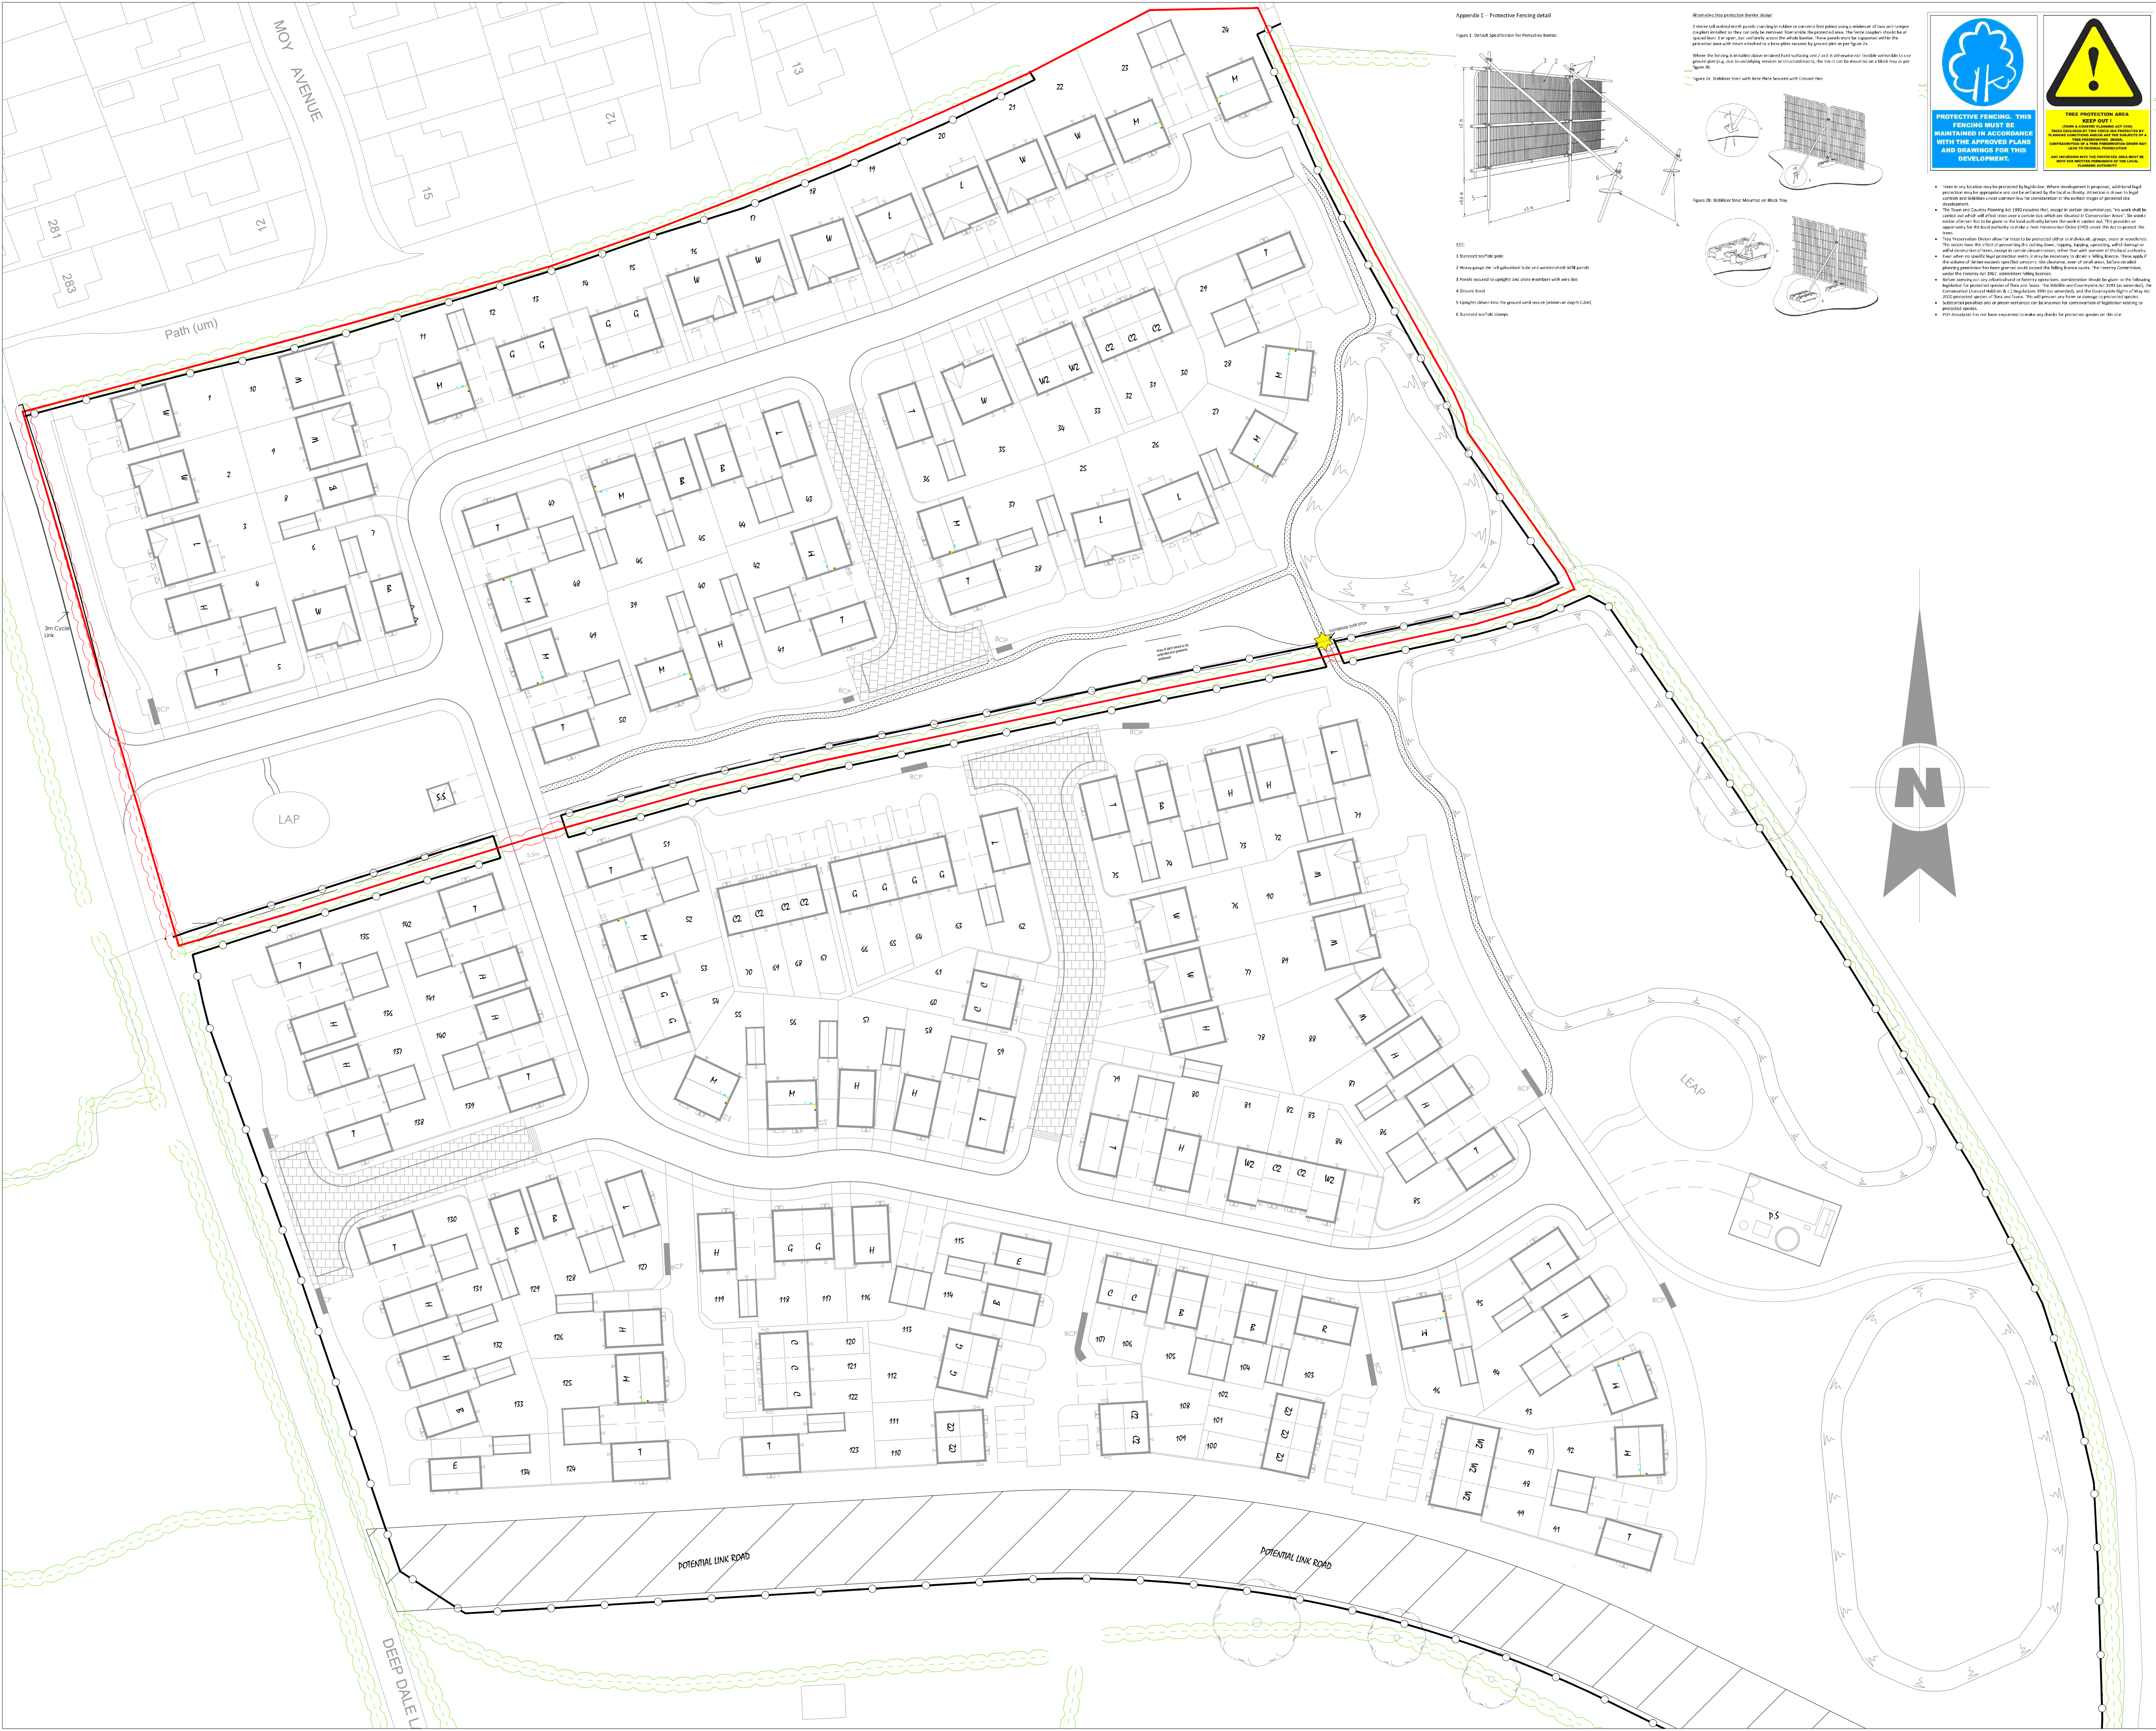


Appendix C - Protective Fencing detail

Figure 1: Detail Specification for Protective Barrier.

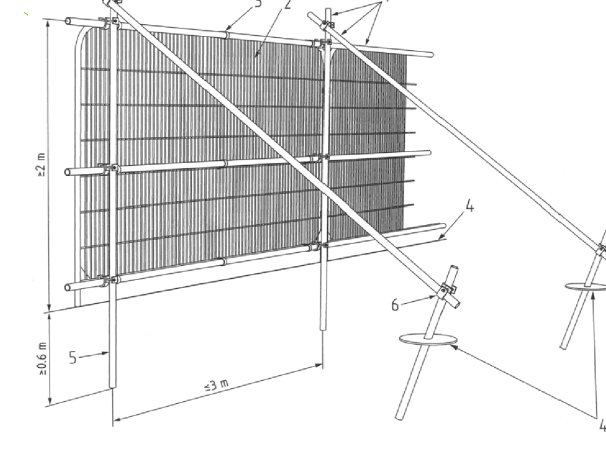

- 1 Standard Suffolk poles
- 2 Heavy gauge 2m x 1.8m galvanized tube and section steel wall panels
- 3 Panels secured to uprights and cross members with wire ties
- 4 Ground level
- 5 Height above into the ground until below (minimum depth 2.0m)
- 6 Standard Suffolk clamps

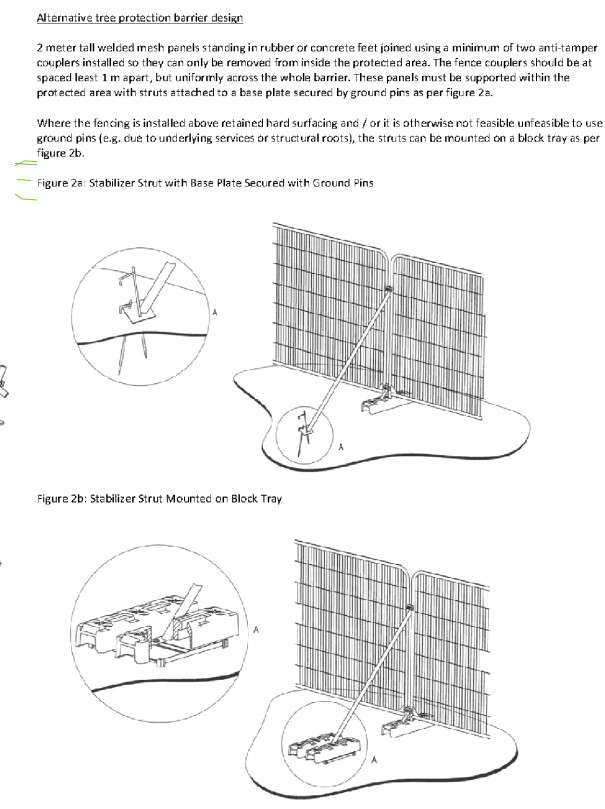

PROTECTIVE FENCING. THIS FENCING MUST BE MAINTAINED IN ACCORDANCE WITH THE APPROVED PLANS AND DRAWINGS FOR THIS DEVELOPMENT.

TREE PROTECTION AREA KEEP OUT!

When the fencing is installed, please ensure that the fence is maintained in accordance with the approved plans and drawings for this development. The fence must be kept in good condition and any damage must be repaired immediately. The fence must be kept in good condition and any damage must be repaired immediately. The fence must be kept in good condition and any damage must be repaired immediately.

PDP Associates

Client
Taylor Wimpey North Midlands

Project
Deepdale Lane, Derby

Drawing title
Tree removal and protection plan

Scale
1:500 @ A1

Drawn by
PDP

Date
Nov 2020

Drawing No.
c-1892-04 Revision B

Revision A: Amended to reflect revised layout changes. PDP: 20.12.20
Revision B: Layout revised to include and protect proposed footpath. The following phases 1 & 2 added. PDP: 20.02.21

Existing hedges, to be removed.

Existing hedges, to be protected and retained.

Location of protective fencing as per BS5837:2012. Minimum suggested distance from centre of hedge to be 2m.

